


# 2" COMBINATION VACUUM/AIR RELEASE

NO SCALE

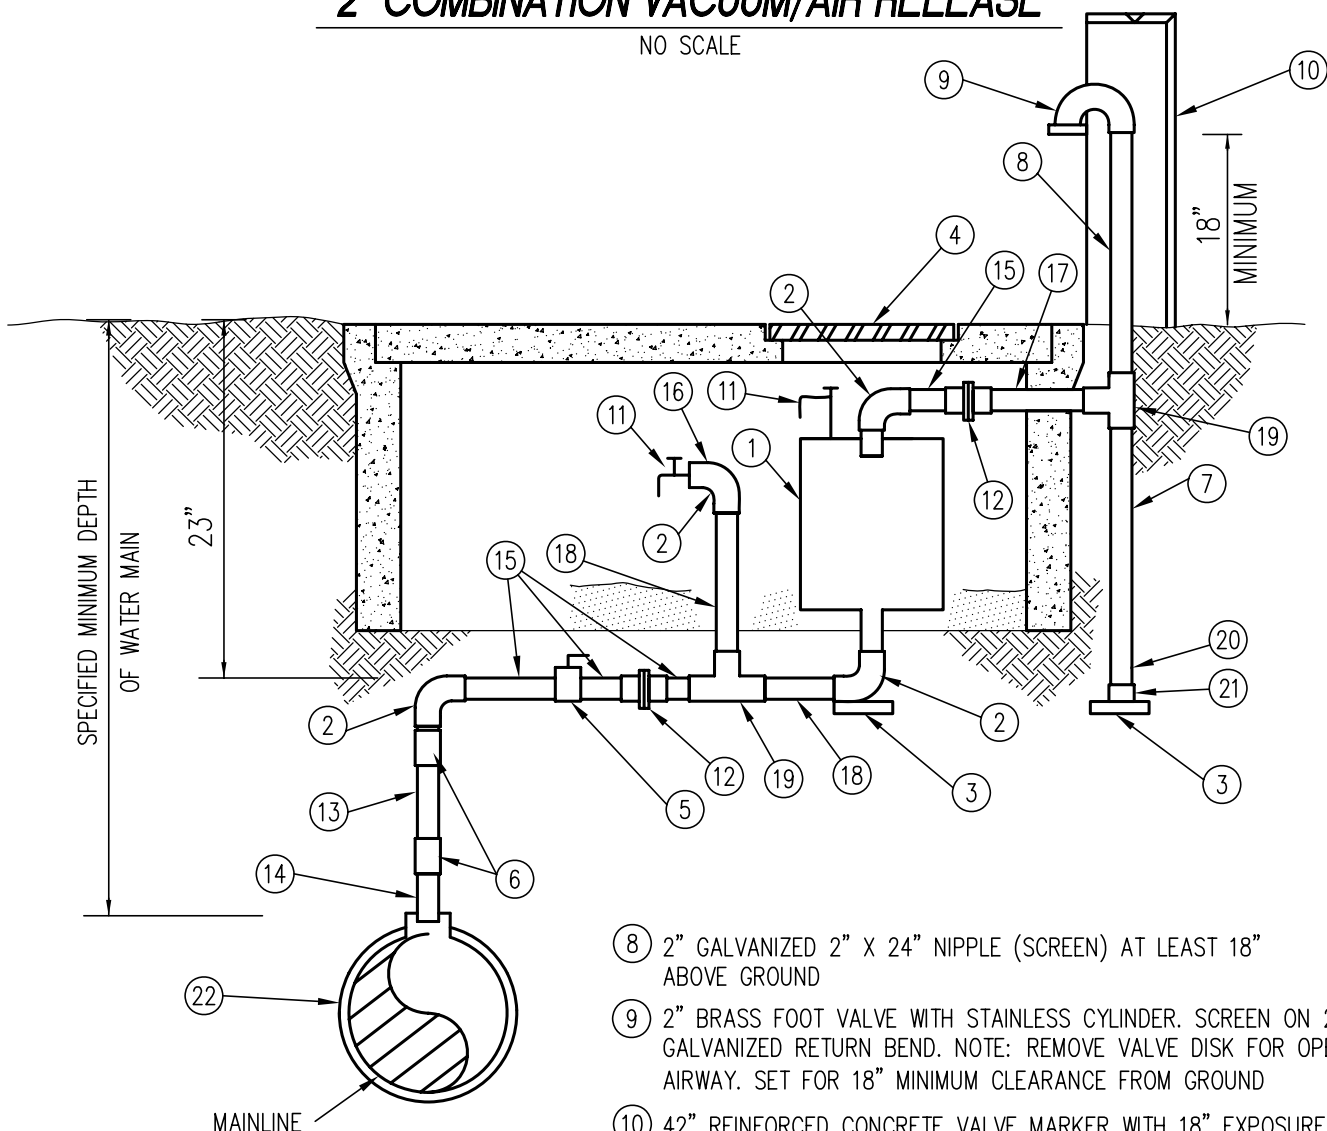

## KEY NOTES

- |   |  |
|---|--|
| <p>① 2" APCO COMBINATION AIR RELEASE VALVE #145C</p> <p>② 2" 90° STREET ELL</p> <p>③ CONCRETE BLOCK SUPPORT (2 PLACES) 12 X 12 X 4</p> <p>④ 24" x 36" x 12" STACKABLE CONCRETE METER BOXES (2 EA. MINIMUM) WITH CONCRETE COVER AND DROP HANDLES. MODEL FOG TITE #2 METER BOX WITH TRAFFIC LID AND INSPECTION LID.</p> <p>⑤ 2" BALL VALVE TH X TH (BRASS)</p> <p>⑥ 2" FEMALE IP X IPS PE PACK JOINT</p> <p>⑦ 2" x 18" GALVANIZED NIPPLE WITH CAP AND 1/8" DRAIN HOLE</p> | <p>⑧ 2" GALVANIZED 2" X 24" NIPPLE (SCREEN) AT LEAST 18" ABOVE GROUND</p> <p>⑨ 2" BRASS FOOT VALVE WITH STAINLESS CYLINDER. SCREEN ON 2" GALVANIZED RETURN BEND. NOTE: REMOVE VALVE DISK FOR OPEN AIRWAY. SET FOR 18" MINIMUM CLEARANCE FROM GROUND</p> <p>⑩ 42" REINFORCED CONCRETE VALVE MARKER WITH 18" EXPOSURE</p> <p>⑪ 3/4" 45° HOSE BIB (1) WITH 2" x 3/4" BUSH REDUCER</p> <p>⑫ 2" GALVANIZED UNION (FLAT FACE)</p> <p>⑬ 2" IPS POLY SDR7</p> <p>⑭ 2" M.I.P. CORP STOP</p> <p>⑮ CLOSE NIPPLE</p> <p>⑯ 2" 90° ELL</p> <p>⑰ 2" x 12" NIPPLE</p> <p>⑱ 2" x 6" NIPPLE</p> <p>⑲ 2" TEE</p> <p>⑳ WEEP HOLE</p> <p>㉑ 2" CAP</p> <p>㉒ SADDLE</p> |
|---|--|



# FIRGROVE MUTUAL WATER COMPANY