


# FIRE HYDRANT PLAN

NO SCALE



CONCRETE GUARD POSTS SHALL ONLY BE REQUIRED WHEN SHOWN ON PROJECT PLANS. THEY SHALL BE 9" DIA. x 6' O.A.L., WITH 4-#3 RE-BARS AND 3500 PSI CONCRETE WITH 1/2" 45 CHAMFER ON TOP. BURY POST 3' WITH TOP 3' EXPOSED.

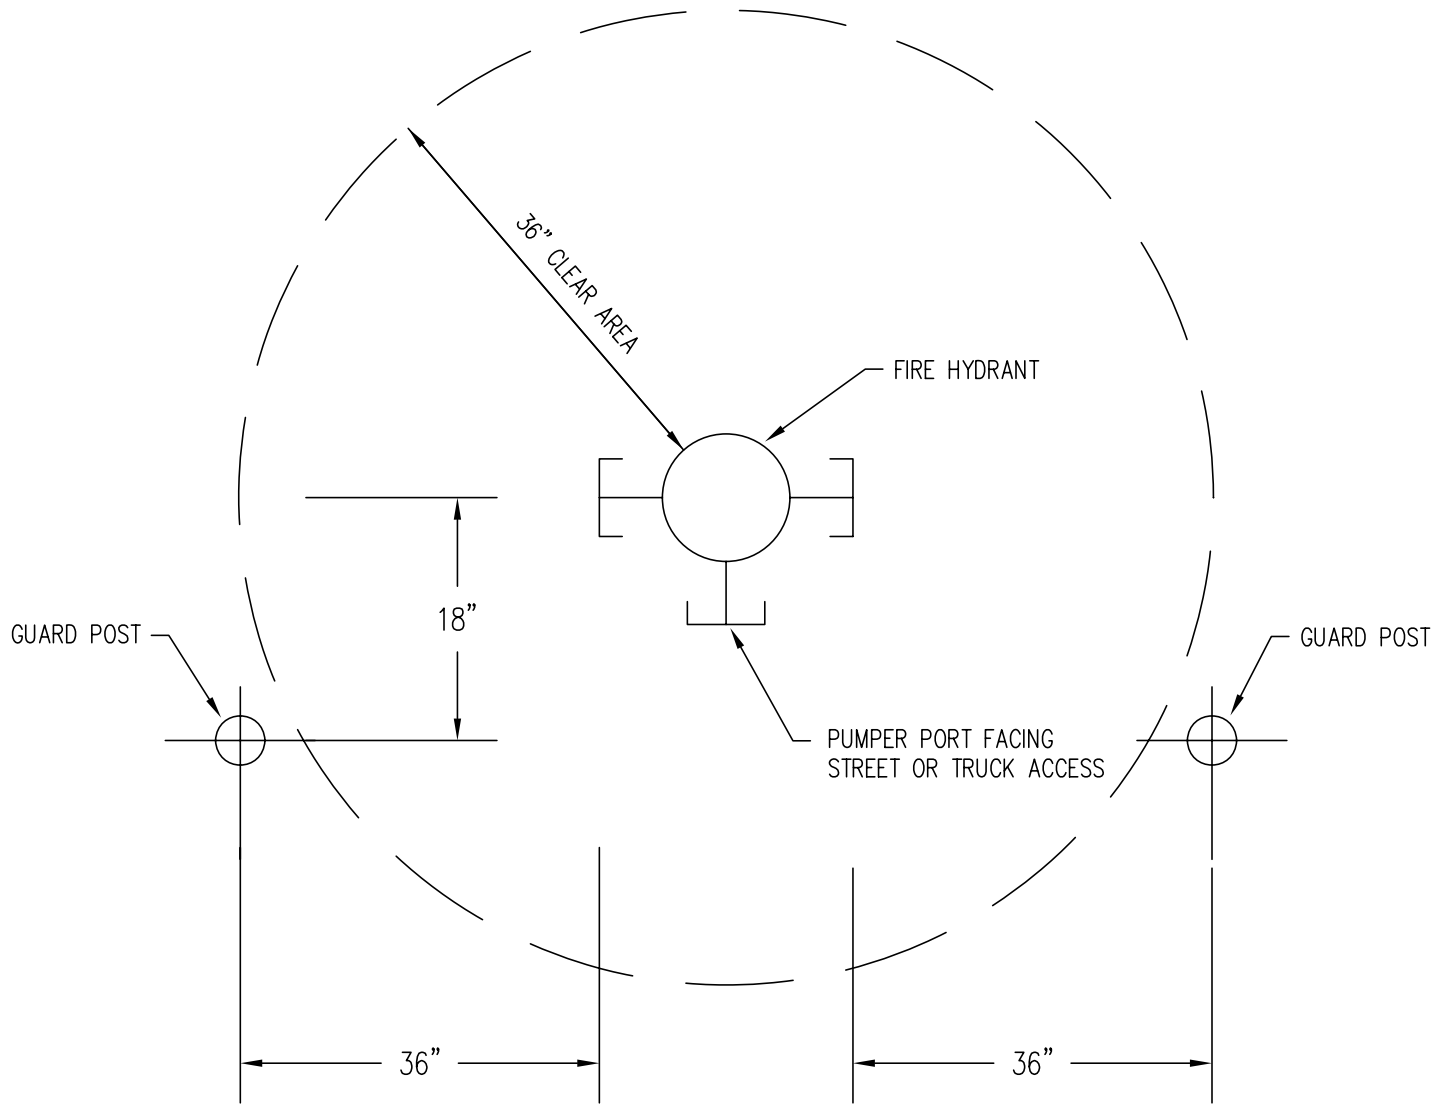

## *FIRGROVE MUTUAL WATER COMPANY*